



## Brooks Farm / Prairie Pointe Water Iron Mitigation Event Log

### Mitigations

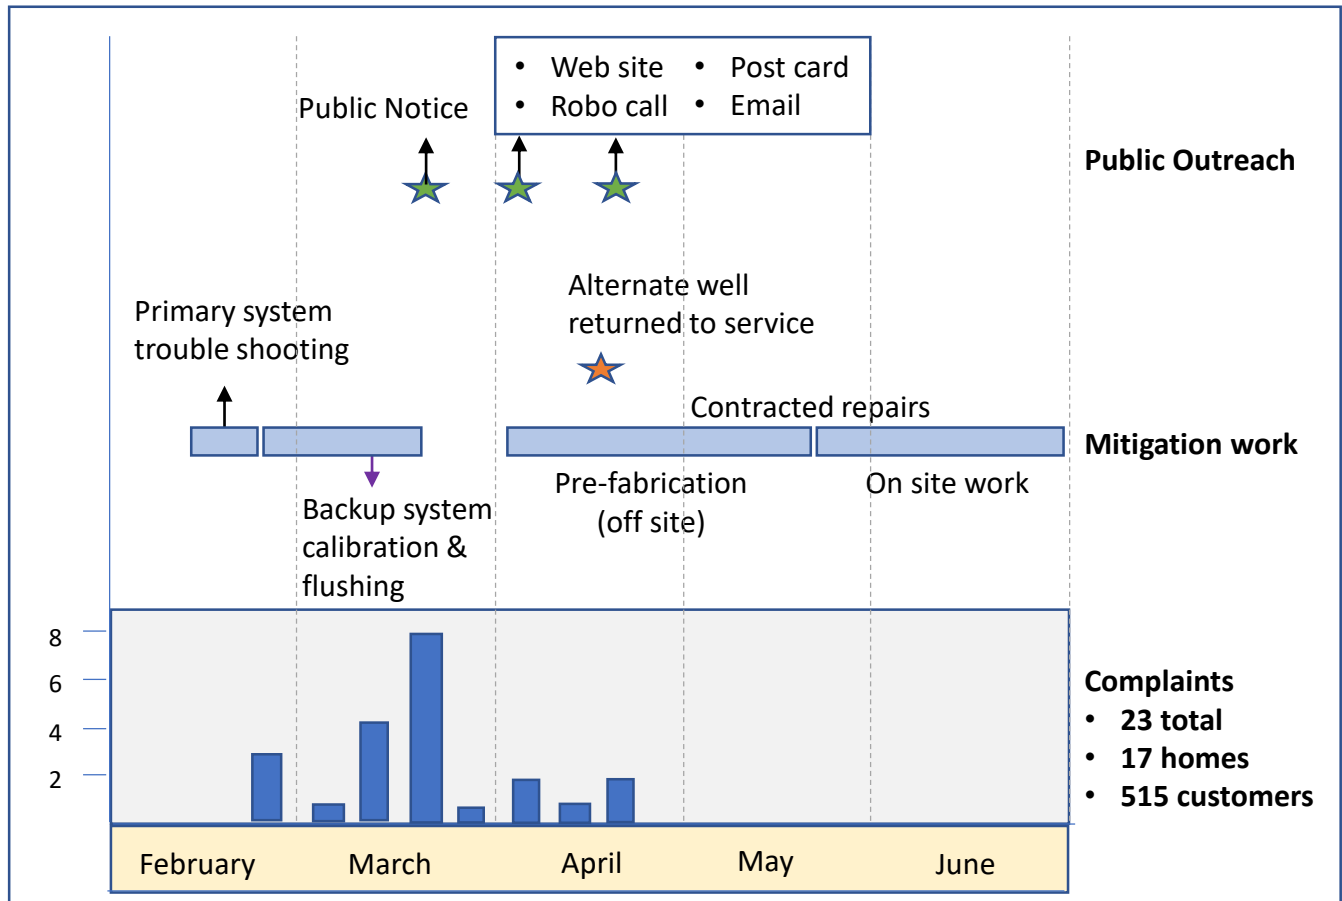

### Water testing

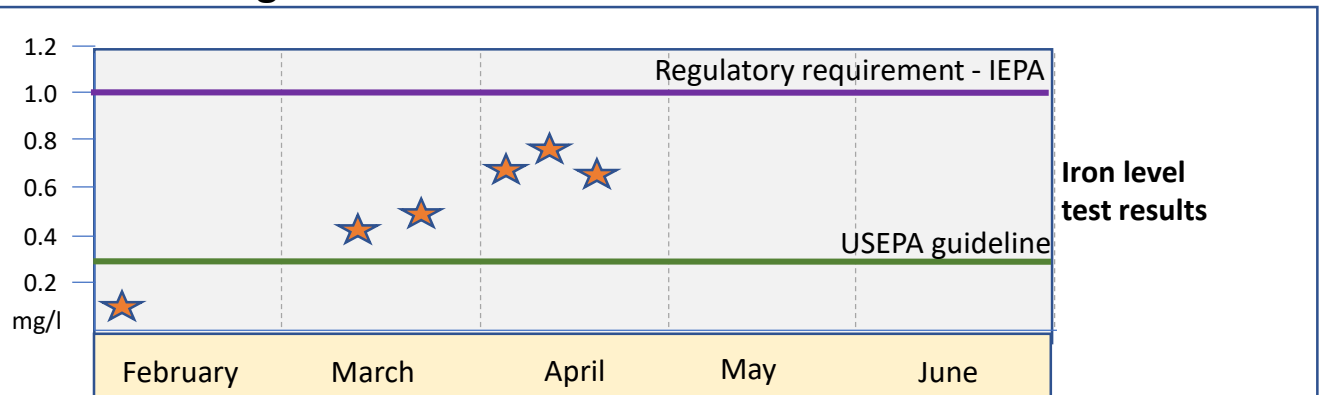

Public Works also performed Coliform Analyses to test for water quality and bacterial contamination. Samples tested from February 6, March 14, and April 4 all came back negative for the presence of E.coli and Coliform bacteria and were satisfactory.



**Shown are the two tanks and related control systems in the Lake County Public Works Iron Filter System for the Prairie Pointe water system. A recently awarded contract for \$210,194.00 will replace the layers of specialized sand, gravel and interior piping of the tanks as well as modernize the electrical control systems. Work is scheduled to be completed in June 2018.**